

SLAB BOX FOR THREE PHASE TRANSFORMERS SB-4

UGS


Revision
↑

DATE: 11/28/06

REVISION: New UGS with a deeper box

DATE: 12/11/06

APPROVAL: *Dave Redding*

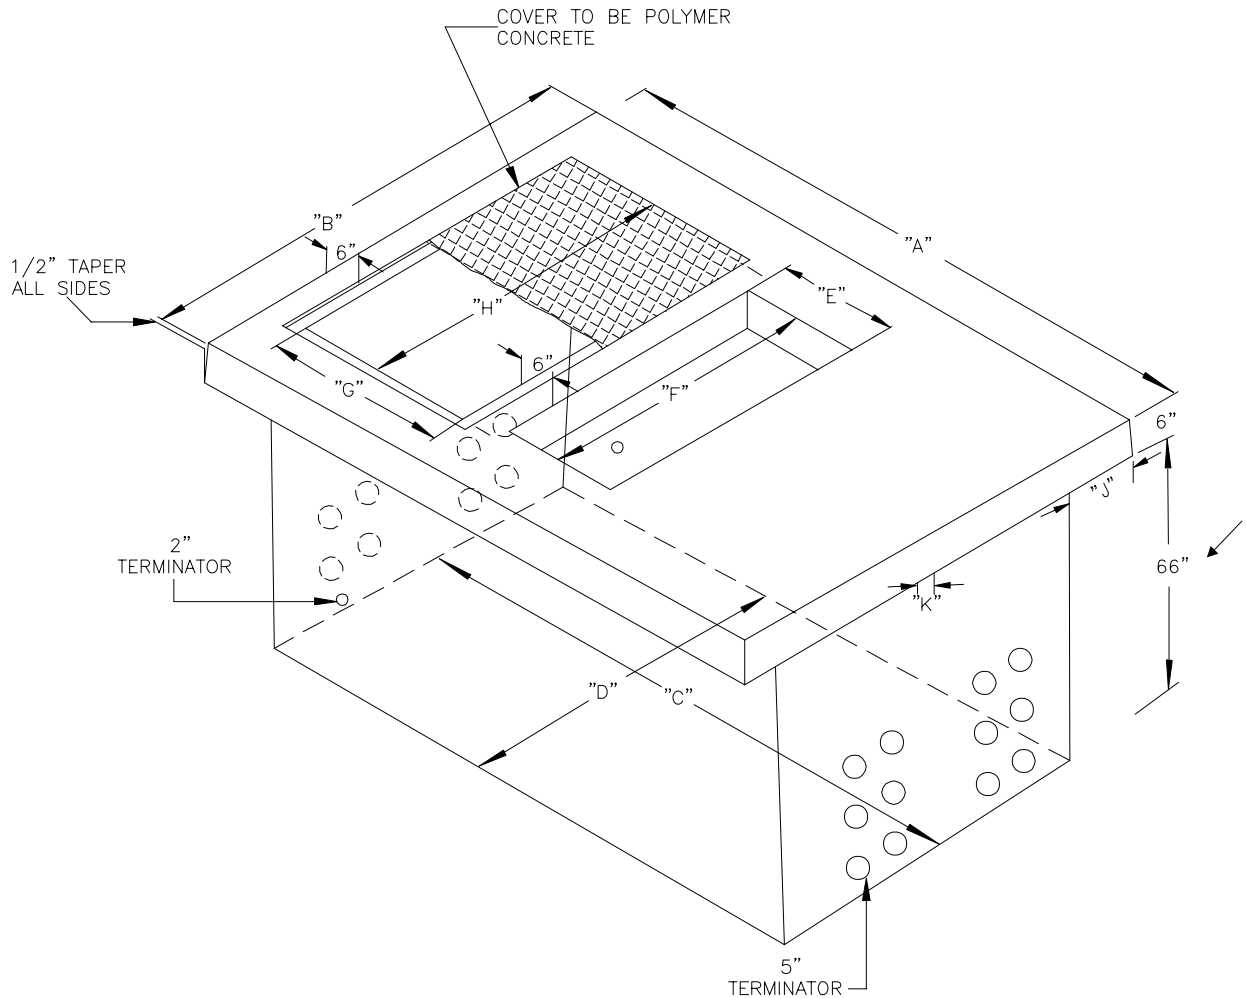

Notes:

1. See UGS-723 for installation of SB-4 Slab-boxes.
2. See UGS-010 for manufacturers of precast slab-boxes and catalog numbers.
3. All slab boxes shall be furnished with a polymer concrete cover with stainless steel, penta head bolts for cover securing.
4. Polymer concrete covers are to be identified as "RIVERSIDE ELECTRIC" as per UGS-050.
5. Grade rings may be used when required. Maximum allowable are 12" grade rings.

ITEM NUMBER	DIMENSIONS—INCHES										
	SLAB		BOX		XFORMER OPENING		ACCESS OPENING		OVERHANG		
	A	B	C	D	E	F	G	H	I	J	K
SB-4	120	96	102	60	24	60	30	48	12	6	6